ACCESSORY KIT INSTRUCTIONS FOR RECESSED WALL MOUNTING



Multi-purpose fan convection heater

Instructions for mounting The Kicker model TK-70 or TK-90 in a recessed wall mount application.

- 1. Change switch location. See Fig. 1.
- 2. Change the location of the air vent by interchanging the ¼" NPT plug and the air vent, both of which are assembled to the coil header. See Fig. 2.
- 3. Attach both side panels to the base of The Kicker with (4) #8 x ¼" screws provided. See Fig. 3.
- 4. Attach bottom rail, plenum and partition to each side with (8) #8 x $\frac{1}{4}$ " sheet metal screws provided. See Fig. 3.
- 5. Mount unit between studs. See Fig. 4.
- 6. Follow instructions packed with The Kicker for water and electrical connections, and for operation.
- 7. Fasten front panel in place with (2) 8 x ½" sheet metal screws provided. See Fig. 3.

PARTS INCLUDED		
Part No.	Qty.	Description
250020000	1	Front panel
250021000	1	Left side
250022000	1	Right side
250023000	1	Plenum
250025000	1	Bottom rail
250029000	1	Partition
970107000	2	#8 x ½" sheet metal screws
980042000	12	#8 x 1/4" sheet metal screws

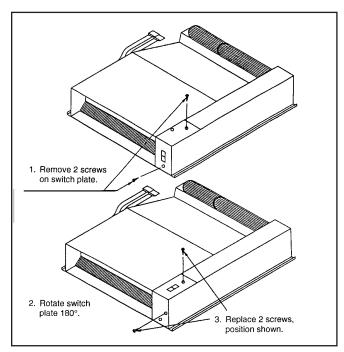


Figure 1. Changing the switch location

The control switch is factory installed for kickspace (horizontal) application. For wall mounting The Kicker in a vertical position, remove the switch assembly and reinstall as shown.

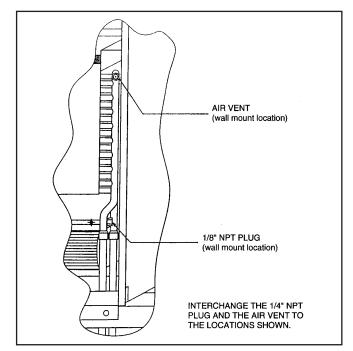


Figure 2. Air vent installation

over



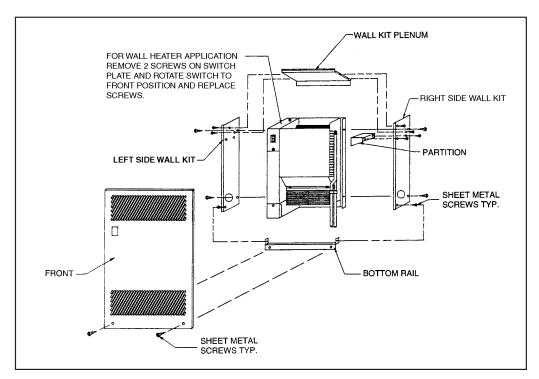


Figure 3. Frame assembly

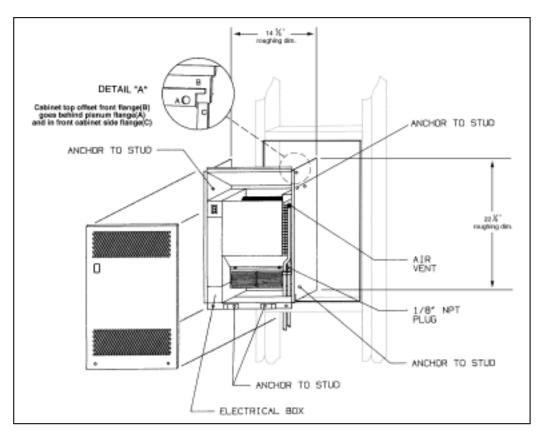


Figure 4. Wall installation

©Slant/Fin Corp. 1994. Printed in U.S.A. 700 Publication TK-40RMK

